

Effect of Sea Level Rise on Energy Infrastructure in the Boston Metropolitan Statistical Area

**Office of Electricity Delivery and Energy Reliability
U.S. Department of Energy**

October 2015



Introduction and Key Findings

This report summarizes recent work undertaken by the Energy Infrastructure and Modeling and Analysis Division (EIMA) of the U.S. Department of Energy Office of Electricity Delivery and Energy Reliability (OE) to assess the potential exposure of energy facilities in the Boston Metropolitan Statistical Area (MSA)¹ to a general rise in sea level and from storm surge at these higher sea levels. The analysis focuses on the risk in 2050 and 2100, and includes more than 650 energy assets in the Boston MSA including electricity assets (including power plants and substations), natural gas assets (including a liquefied natural gas (LNG) terminal and pipelines), and petroleum assets (including terminals).

The analysis indicates that under the U.S. National Climate Assessment (NCA) Low Sea Level Rise (SLR) Scenario, 1 foot of inundation will occur well after 2100 in the Boston MSA. Under the NCA Intermediate-High Scenario, 1 foot of inundation will occur prior to 2050, 4 feet of inundation just after 2100, and 5 feet of inundation at approximately 2115, depending on location within the MSA.²

The analysis results show that with 1 foot of SLR under the NCA Intermediate-High SLR Scenario of the large energy assets analyzed, only one petroleum terminal and seven natural gas pipelines would be inundated in the Boston MSA by 2050. However, the Boston MSA has many large assets clustered near the Boston and Portsmouth harbors and a 1-foot SLR in conjunction with a storm surge associated with a Category 4 storm would inundate many of these large and critical electricity and petroleum assets including:

- 5 substations (>230 kV)
- 5 power plants (>100 MW)
- 11 petroleum terminals (>100,000 bbl)
- 7 natural gas pipelines

In 2100, with 4 feet of SLR under the NCA Intermediate-High Scenario, the SLR alone would inundate one large substation, five large petroleum terminals, and portions of seven natural gas pipelines. A storm surge associated with a Category 1 storm in addition to 4 feet of SLR would cause considerable inundation, including the following large assets:

- 2 substations
- 4 power plants
- 9 petroleum terminals
- 7 natural gas pipelines

A storm surge associated with a Category 4 storm in conjunction with 4 feet of SLR would inundate most of the large coastal energy infrastructure in the MSA.

The remainder of this report provides background on the analysis and describes important caveats. An Appendix presents the detailed information in a table and set of maps. A second Appendix provides additional detail on the approach to estimating SLR and storm surge.

¹ The U.S. Census Bureau defines the Boston MSA as consisting of seven counties in Massachusetts and New Hampshire and the city of Boston. The counties are Plymouth, Norfolk, Suffolk, Middlesex, and Essex counties (MA) and Rockingham and Strafford Counties (NH). The MSA has a total population of about 4.2 million.

² Four feet is used in the figures presented in this report, representing the approximate level of inundation in the Boston MSA at the end of the century (i.e., 2100) under the NCA Intermediate-High SLR Scenario.

Background and Approach

The EIMA Division within OE conducts studies of potential risks to the nation's energy infrastructure. EIMA's mission is to ensure the reliability and resiliency of U.S. energy infrastructure and systems through robust analytical, modeling, and assessment capabilities. The Division is focused on conducting risk analyses and predictive modeling, and providing analytical products intended to inform decision makers at the public and private levels.

In 2014, EIMA launched an effort to evaluate the effects of SLR on energy assets. A pilot study was conducted that examined the implications of SLR for energy assets in four MSAs—New York, Miami, Houston, and Los Angeles. The goal of the study was to demonstrate an effective approach to examining SLR that could be generalized and extended to other regions of the country. The final report, published in September 2014, describes the analytical approach and the results of the study. The study relied on scenarios of sea level rise developed by the NCA. These include a range of plausible trajectories of global mean SLR, ranging from 8 inches to 6.6 feet by 2100.³ For the purpose of assessing the exposure of energy assets to SLR, the study used the NCA's SLR scenarios, adjusted for local factors, such as subsidence. For a detailed explanation of how the SLR analysis was conducted please see Chapter 3 of the report.⁴

The pilot study examined energy facilities at risk from SLR but did not take into account impacts from storm surge. In late 2014, the Oak Ridge National Laboratory (ORNL) published a report demonstrating a method for incorporating storm surge with SLR.⁵ EIMA has adapted that approach and has begun to evaluate the combined effects of SLR and storm surge on energy assets. Boston is one of the first areas to which this method has been applied.

The method employed for this analysis uses the approach from the pilot study for estimating sea level rise impacts and adapts the approach developed by ORNL that adds storm surge modeled inundations as developed by NOAA's National Weather Service using the Sea, Lake and Overland Surges from Hurricanes (SLOSH) model.⁶ Surge is estimated based on a composite of model runs assuming hypothetical hurricanes of varying characteristics. The result is a Maximum Envelope of Water (MEOW) which shows the highest surge values at each grid location for a given storm characteristic. This study uses the Maximum of MEOWs, or MOM, for estimates of storm surge heights. Storm surge associated with intense storms was mapped on top of the SLR. This calculated elevation was then extended toward the coast to find the extent of the possible inundation. These inundation layers were then intersected with the infrastructure locations to determine facilities that may be affected by such a combined impact (for example, what power plants might be inundated by a Category 4 storm occurring after 4 feet of sea level rise). No new numerical modeling was conducted for this study. (See Appendix B for additional details on the methodology.)⁷

³ Parris, A., et al. 2012. Global Sea Level Rise Scenarios for the US National Climate Assessment. NOAA Tech Memo OAR CPO-1.

⁴ A copy of the report, *Effects of Sea Level Rise on Energy Infrastructure in Four Major Metropolitan Areas* (2014), can be downloaded at <http://energy.gov/oe/downloads/effect-sea-level-rise-energy-infrastructure-four-major-metropolitan-areas-september>.

⁵ Maloney, M.C. and B.L. Preston, 2014. A geospatial dataset for U.S. hurricane storm surge and sea-level rise vulnerability: Development and case study applications. *Climate Risk Management*, 2, 26-41.

⁶ Available at: <http://www.nhc.noaa.gov/surge/slosh.php>.

⁷ The SLOSH model estimates storm surge heights associated with hurricanes by simulating the effects of storm size, forward speed, track, wind speed, and atmospheric pressure on water heights in the coastal zone. Model output data are available for

During the course of this analysis, it became apparent that several assets, while not completely inundated, were obviously projected to be affected by SLR and storm surge. Assets were deemed to be *affected* if they are projected to be completely surrounded by water or if water encroaches the sites but does not completely envelop the facilities. A visual assessment was made to determine whether non-inundated large assets might be affected. Both types of impacts were identified in the analysis.

For the purpose of this analysis, two storm categories were examined. Category 1 storms were analyzed to illustrate the effects of exacerbation from SLR on smaller storms. Based on the historical record of storms there is a 43 percent chance that a hurricane will make landfall at some point in a 50-year period in Suffolk County, where Boston is located. There is a 5 percent chance of a land-falling Category 3 storm in the same period.⁸ This study does not address the potential changes in return intervals of hurricanes⁹, which may be different under future conditions and affect coastal vulnerabilities.¹⁰ To account for potentially stronger storms in the future, the study analyzed Category 4 storms.

The objective of this and the other studies has been to develop a first order estimate of the exposure of energy assets to SLR by itself and future storm surge at the higher sea levels forecast by the NCA. It is expected that where these studies identify potential exposure, more detailed studies could be undertaken to refine and better understand the risks. These studies aim to align the analysis and results with the level of detail and certainty needed to inform decisions regarding which energy assets may be vulnerable to SLR and storm surge.

Caveats and Limitations

Because of the relatively high-level nature of the SLR and storm surge analysis, there are limitations that should be acknowledged. The study employs a method of moderate complexity that takes advantage of publicly available data and can be run with standard desktop processing power, while providing results at a level of certainty sufficient to identify the potential effects of combined SLR and storm surge. These features make the method useful for comparing results across multiple areas. The method also localized estimates of SLR from global projections using information about local SLR trends, improving the accuracy of results.

Useful Life of Energy Assets – The SLR study extends beyond the economic life of most of the energy assets shown to be affected. Many of these assets could be retired within the next 25 to 30 years. The analysis does identify, however, the potential risk areas for the location of new assets.

Asset Hardening and Protection – The data do not indicate whether utility or facility operators have undertaken projects to reduce exposure to higher sea levels. In some areas, asset owners have been making efforts to minimize exposure to high water—by

39 basins along the Atlantic and Gulf coasts. The SLR data are from the NOAA Coastal Services Center (NOAA CSC) inundation maps showing shoreline effects of SLR between 1 and 6 feet in 1-foot increments. The land surface data are from USGS National Elevation Dataset output.

⁸ Available at: <http://landfalldisplay.geolabvirtualmaps.com/>.

⁹ Melillo, Jerry M., Terese (T.C.) Richmond, and Gary W. Yohe, Eds., 2014: Climate Change Impacts in the United States: The Third National Climate Assessment. U.S. Global Change Research Program, 841 pp. doi:10.7930/J0Z31WJ2.

¹⁰ Maloney and Preston, 2014.

the construction of berms, for example. However, information on the types of hardening or resilience measures taken by asset owners and operators is not accounted for in the study. Also not accounted for are sea walls, dunes, or other factors that would impede permanent inundation or temporary flooding.

Asset Interdependencies – The study does not identify interdependencies among energy assets, such as for example, the effect of a substation outage on another energy asset.

Data Limitations – The study relies on data regarding energy assets drawn from numerous sources. The scope of this study included hundreds of assets, including many small assets. (The accompanying maps show only the large energy assets.) Sometimes these data are incomplete or assets are not accurately located.

Modeling Limitations – There are trade-offs regarding resolution and certainty of modeling results. The underlying models of future changes to global sea levels have various sources of uncertainty that also contribute to uncertainty of models of relative sea levels and the interactive effects of sea level rise and storm surge. The SLR analysis does not take into account erosion. The method used in this study takes an additive approach to SLR and storm surge, which does not fully capture the nonlinear interaction of SLR and storm surge;¹¹ therefore, in instances where there is less tolerance for uncertainty, surge modeling may need to be performed on the projected future local sea level.

The SLOSH model does not include wind-driven waves or waves on top of surge, rainfall amounts, or river flows when determining surge height.¹² The model also lacks processes such as coastal accretion and recession, changes in near-shore bathymetry, and coastal barrier features,¹³ which can affect local estimates of total water height during a storm. The SLOSH model resolution is also coarse compared to state-of-the-art surge models, such as the ADCIRC model,¹⁴ which contributes to uncertainty in the findings. In some cases this results in inundation mapping that appears not to follow a natural shoreline and are unnaturally straight or have geometric shapes.

Future Policy – The results, as presented, assess exposure of present-day energy infrastructure over the next 85 years to SLR and storm surge. Future changes to energy infrastructure—through modifications such as asset hardening and new construction, among others—are not accounted for in this study. Activities planned in the Boston area by local government are not reflected in the modeling.

¹¹ Zhang, K. Li, Y., and Liu, H. (2013) Comparison of three methods for estimating the sea level rise effect on storm surge flooding. *Climatic Change* 118:487–500.

¹² Available at: <http://www.nhc.noaa.gov/surge/faq.php#10>.

¹³ Maloney and Preston, 2014.

¹⁴ Available at: <http://adcirc.org/>.

Next Steps

EIMA is pleased to share this analysis with the hope that it fulfills the purpose for which it has been undertaken: to identify areas of potential exposure that can lead to more detailed analysis. EIMA hopes that this study will be useful in work ongoing in the Boston region with regard to energy asset impacts from sea level rise.

Contact

The Energy Infrastructure Modeling and Analysis (EIMA) division is focused on ensuring the reliability and resiliency of the U.S. electric grid through robust analytical, modeling, and assessment capabilities to address issues of national importance.

For more information about the analysis included herein, please contact:

Office of Electricity Delivery and Energy Reliability
U.S. Department of Energy

EnergyAnalysis@hq.doe.gov

Appendix A: Table and Maps of Results

The following pages contain a table and maps from the results of the analysis. An explanatory note for Table 1 is provided here and additional details can be found noted in the subsequent figures. Maps are only provided for those scenarios and time periods (i.e., 2050 or 2100) where assets are projected to be inundated; under the Intermediate-High Scenario in 2050 of 1-foot SLR, only one petroleum terminal and portions of pipeline assets are projected to be inundated and no map is provided.

More than 650 assets were examined including 26 large energy assets:

- >160 power plants
- >330 substations
- 17 petroleum terminals
- 7 natural gas pipelines
- 1 LNG terminal

There are 779 miles of natural gas pipeline in the MSA. This study analyzed potential inundation of these pipelines.

Asset data sources included the following: for electric assets: Homeland Security Infrastructure Protection Gold (HSIP Gold), 2011 and Ventyx, accessed July 2015; for natural gas assets: HSIP Gold, 2013; for petroleum assets: HSIP Gold, 2013 and Argonne National Labs, accessed 2013.

The maps present specific information on only the large energy assets in the MSA, specifically:

- power plants greater than 100 MW and substations greater than 230 kV
- petroleum terminals greater than 100,000 barrels storage capacity
- LNG terminal of any size and natural gas pipelines

Table 1. Years Corresponding to SLR Increments in Boston MSA under Four NCA Scenarios

The analysis begins with SLR. Table 1 shows the years in which sea levels are projected to increase from their current level to 1 foot higher, 2 feet higher, and up through 6 feet of sea level rise under each of the NCA SLR scenarios. The SLR data are from the NOAA Coastal Services Center (NOAA CSC) inundation maps showing shoreline effects of SLR between 1 and 6 feet in 1-foot increments.¹⁵ The calculation of the year takes into account local subsidence trends using tidal information from NOAA, National Ocean Service.¹⁶ The columns highlighted in red are for SLR by 2050 (midcentury); the columns highlighted in yellow are for SLR by 2100 (end of century). The timing of inundation is important for informing risk management actions, and results from 2050 and 2100 are presented to give perspective on potential near-term and long-term levels of inundation, which may require different actions or affect different types of decisions.

Additional Figures

Figure 1a. Large Electricity Assets Inundated by 4-Foot SLR under the NCA Intermediate-High Scenario in Boston MSA by ~2100

¹⁵ Available at: <http://coast.noaa.gov/slrdata/>.

¹⁶ Tidal Datums. Available at: http://tidesandcurrents.noaa.gov/datum_options.html.

Figure 1b. Large Petroleum and Natural Gas Assets Inundated by 4-Feet SLR under the NCA Intermediate-High Scenario in Boston MSA by ~2100

Figure 2a. Large Electricity Assets Inundated by 1-Foot SLR under the NCA Intermediate-High Scenario and Category 1 Storm Surge in Boston MSA

Figure 2b. Large Petroleum and Natural Gas Assets Inundated by 1-Foot SLR under the NCA Intermediate-High Scenario and Category 1 Storm Surge in Boston MSA

Figure 3a. Large Electricity Assets Inundated by 1-Foot SLR under the NCA Intermediate-High Scenario and Category 4 Storm Surge in Boston MSA

Figure 3b. Large Petroleum and Natural Gas Assets Inundated by 1-Foot SLR under the NCA Intermediate-High Scenario and Category 4 Storm Surge in Boston MSA

Figure 4a. Large Electricity Assets Inundated by 4-Feet SLR under the NCA Intermediate-High Scenario and Category 1 Storm Surge in Boston MSA

Figure 4b. Large Petroleum and Natural Gas Assets Inundated by 4-Feet SLR under the NCA Intermediate-High Scenario and Category 1 Storm Surge in Boston MSA

Figure 5a. Large Electricity Assets Inundated by 4-Feet SLR under the NCA Intermediate-High Scenario and Category 4 Storm Surge in Boston MSA

Figure 5b. Large Petroleum and Natural Gas Assets Inundated by 4-Feet SLR under the NCA Intermediate-High Scenario and Category 4 Storm Surge in Boston MSA

Table 1. Years Corresponding to SLR Increments in Boston MSA under Four NCA Scenarios

County	NCA Low Scenario						NCA Intermediate-Low Scenario					
	1 Ft	2 Ft	3 Ft	4 Ft	5 Ft	6 Ft	1 Ft	2 Ft	3 Ft	4 Ft	5 Ft	6 Ft
Essex, MA	>2100	>2100	>2100	>2100	>2100	>2100	2071	>2100	>2100	>2100	>2100	>2100
Middlesex, MA	>2100	>2100	>2100	>2100	>2100	>2100	2071	>2100	>2100	>2100	>2100	>2100
Norfolk, MA	>2100	>2100	>2100	>2100	>2100	>2100	2071	>2100	>2100	>2100	>2100	>2100
Plymouth, MA	>2100	>2100	>2100	>2100	>2100	>2100	2071	>2100	>2100	>2100	>2100	>2100
Suffolk, MA	>2100	>2100	>2100	>2100	>2100	>2100	2071	>2100	>2100	>2100	>2100	>2100
Rockingham, NH	>2100	>2100	>2100	>2100	>2100	>2100	2080	>2100	>2100	>2100	>2100	>2100
Strafford, NH	>2100	>2100	>2100	>2100	>2100	>2100	2080	>2100	>2100	>2100	>2100	>2100
	NCA Intermediate-High Scenario						NCA High Scenario					
	1 Ft	2 Ft	3 Ft	4 Ft	5 Ft	6 Ft	1 Ft	2 Ft	3 Ft	4 Ft	5 Ft	6 Ft
Essex, MA	2045	2067	2085	2101	>2100	>2100	2035	2052	2065	2076	2086	2095
Middlesex, MA	2045	2067	2085	2101	>2100	>2100	2035	2052	2065	2076	2086	2095
Norfolk, MA	2045	2067	2085	2101	>2100	>2100	2035	2052	2065	2076	2086	2095
Plymouth, MA	2045	2067	2085	2101	>2100	>2100	2035	2052	2065	2076	2086	2095
Suffolk, MA	2045	2067	2085	2101	>2100	>2100	2035	2052	2065	2076	2086	2095
Rockingham, NH	2048	2071	2089	>2100	>2100	>2100	2037	2053	2067	2078	2088	2097
Strafford, NH	2048	2071	2089	>2100	>2100	>2100	2037	2053	2067	2078	2088	2097

Notes:

- * Red cells indicate when the inundation level (in feet) shown in the top row occurs around 2050 and well before 2100;
- * Yellow cells indicate when inundation levels (in feet) shown in the top row occurs between 2050 and approximately 2100. In the NCA Intermediate-High scenario, four feet of inundation is projected at or near to 2100 and therefore shaded yellow.
- * The analysis above incorporates the National Climate Assessment scenarios for SLR as described in *Global Sea Level Rise Scenarios for the U.S. National Climate Assessment*. NOAA Tech Memo OAR CPO-1. NOAA Climate Program Office (2012), http://cpo.noaa.gov/sites/cpo/Reports/2012/NOAA_SLR_r3.pdf.
- * The inundation levels are taken from NOAA, Coastal Services Center. *Method Description - Detailed Methodology for Mapping Sea Level Rise Inundation* (2012), http://www.csc.noaa.gov/slr/viewer/assets/pdfs/Inundation_Methods.pdf.
- * The years in which the levels of inundation would occur under each NCA scenario are adjusted for local subsidence trends using tidal information from NOAA, National Ocean Service. *Tidal Datums*. http://tidesandcurrents.noaa.gov/datum_options.html.
- * As noted in the text, a more detailed methodological discussion appears in *Effects of Sea Level Rise on Energy Infrastructure in Four Major Metropolitan Areas* (2014), <http://energy.gov/oe/downloads/effect-sea-level-rise-energy-infrastructure-four-major-metropolitan-areas-september>.

Figure 1a. Large Electricity Assets Inundated by 4-Foot SLR under the NCA Intermediate-High Scenario in Boston MSA by ~2100

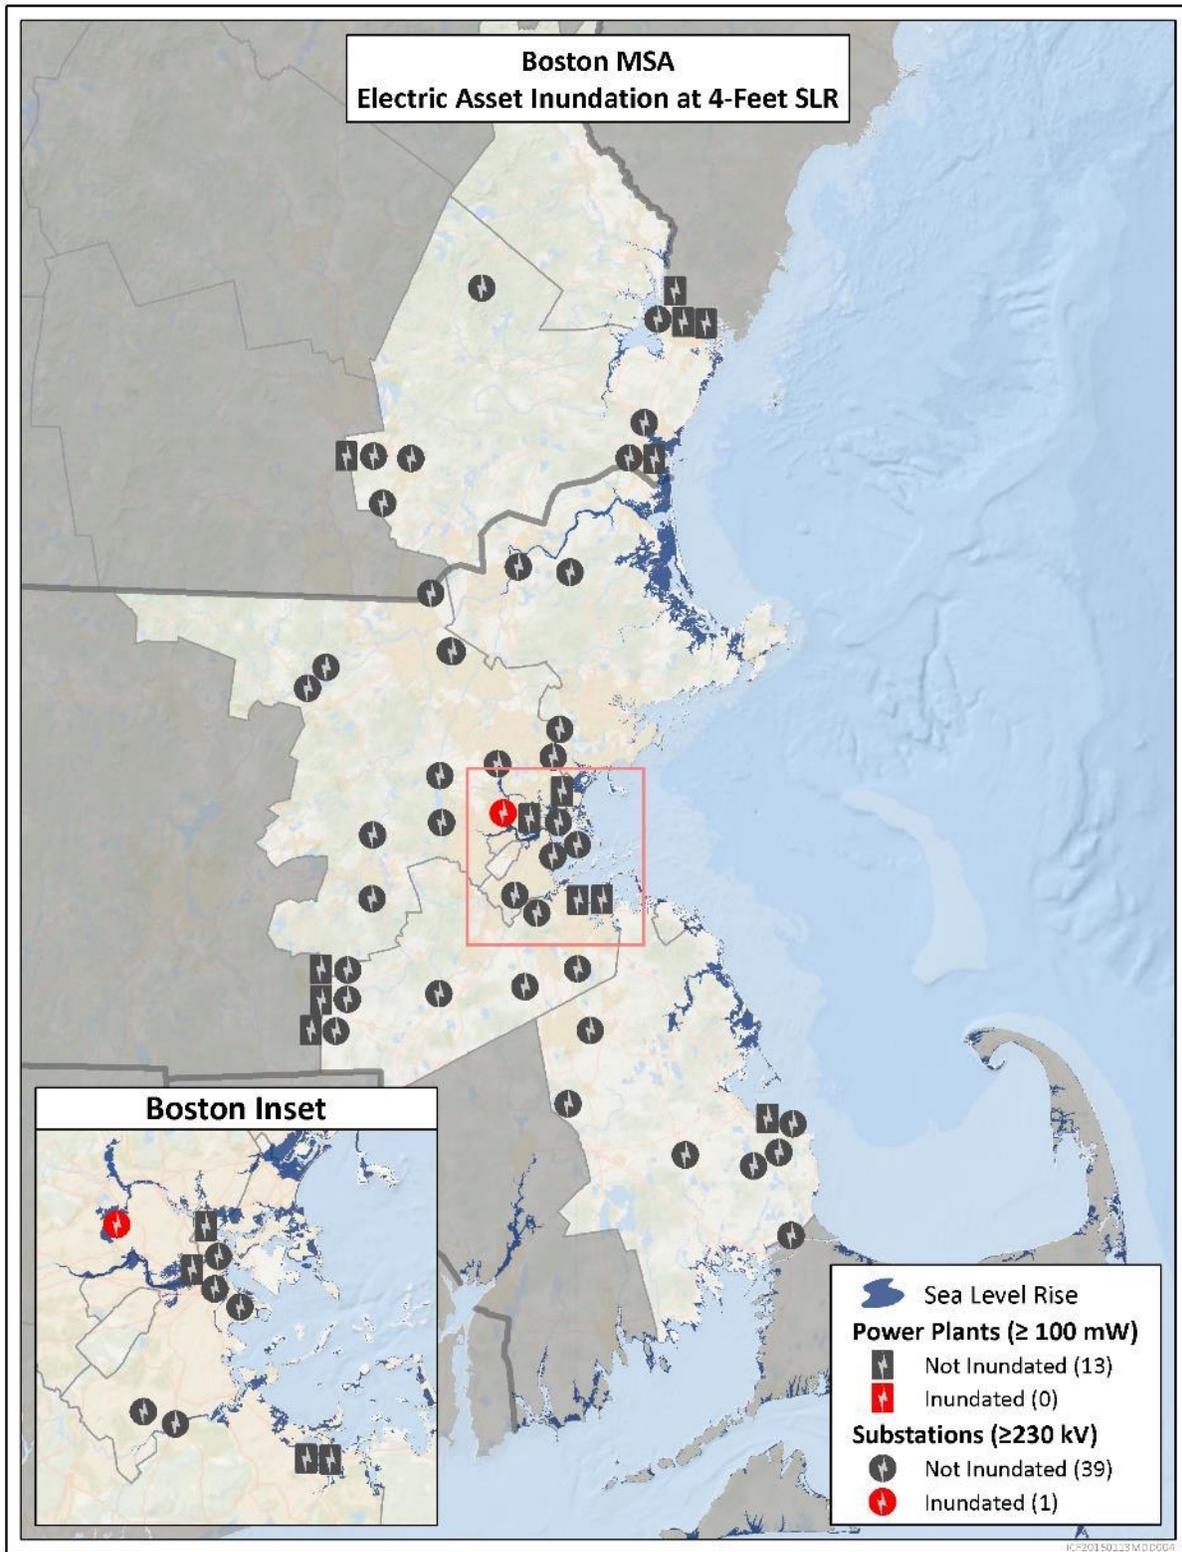


Figure 1b. Large Petroleum and Natural Gas Assets Inundated by 4-Foot SLR under the NCA Intermediate-High Scenario in Boston MSA by ~2100

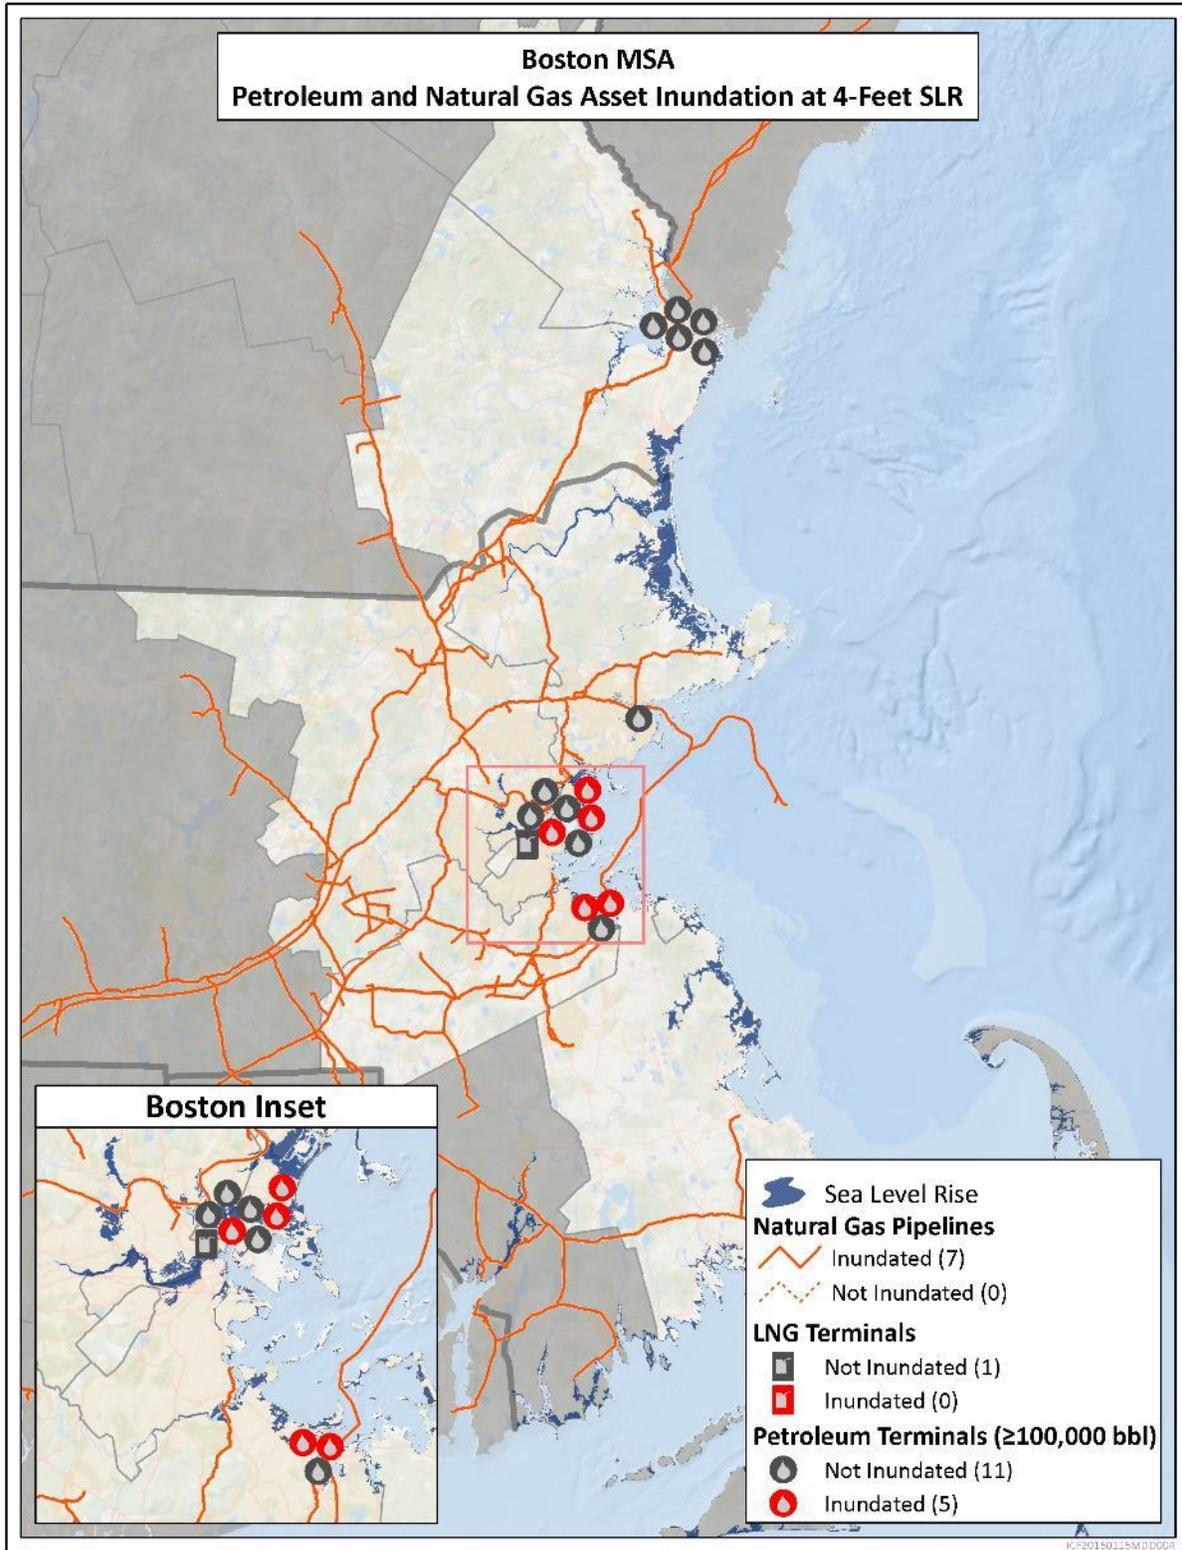


Figure 2a. Large Electricity Assets Inundated by 1-Foot SLR under the NCA Intermediate-High Scenario and Category 1 Storm Surge in Boston MSA

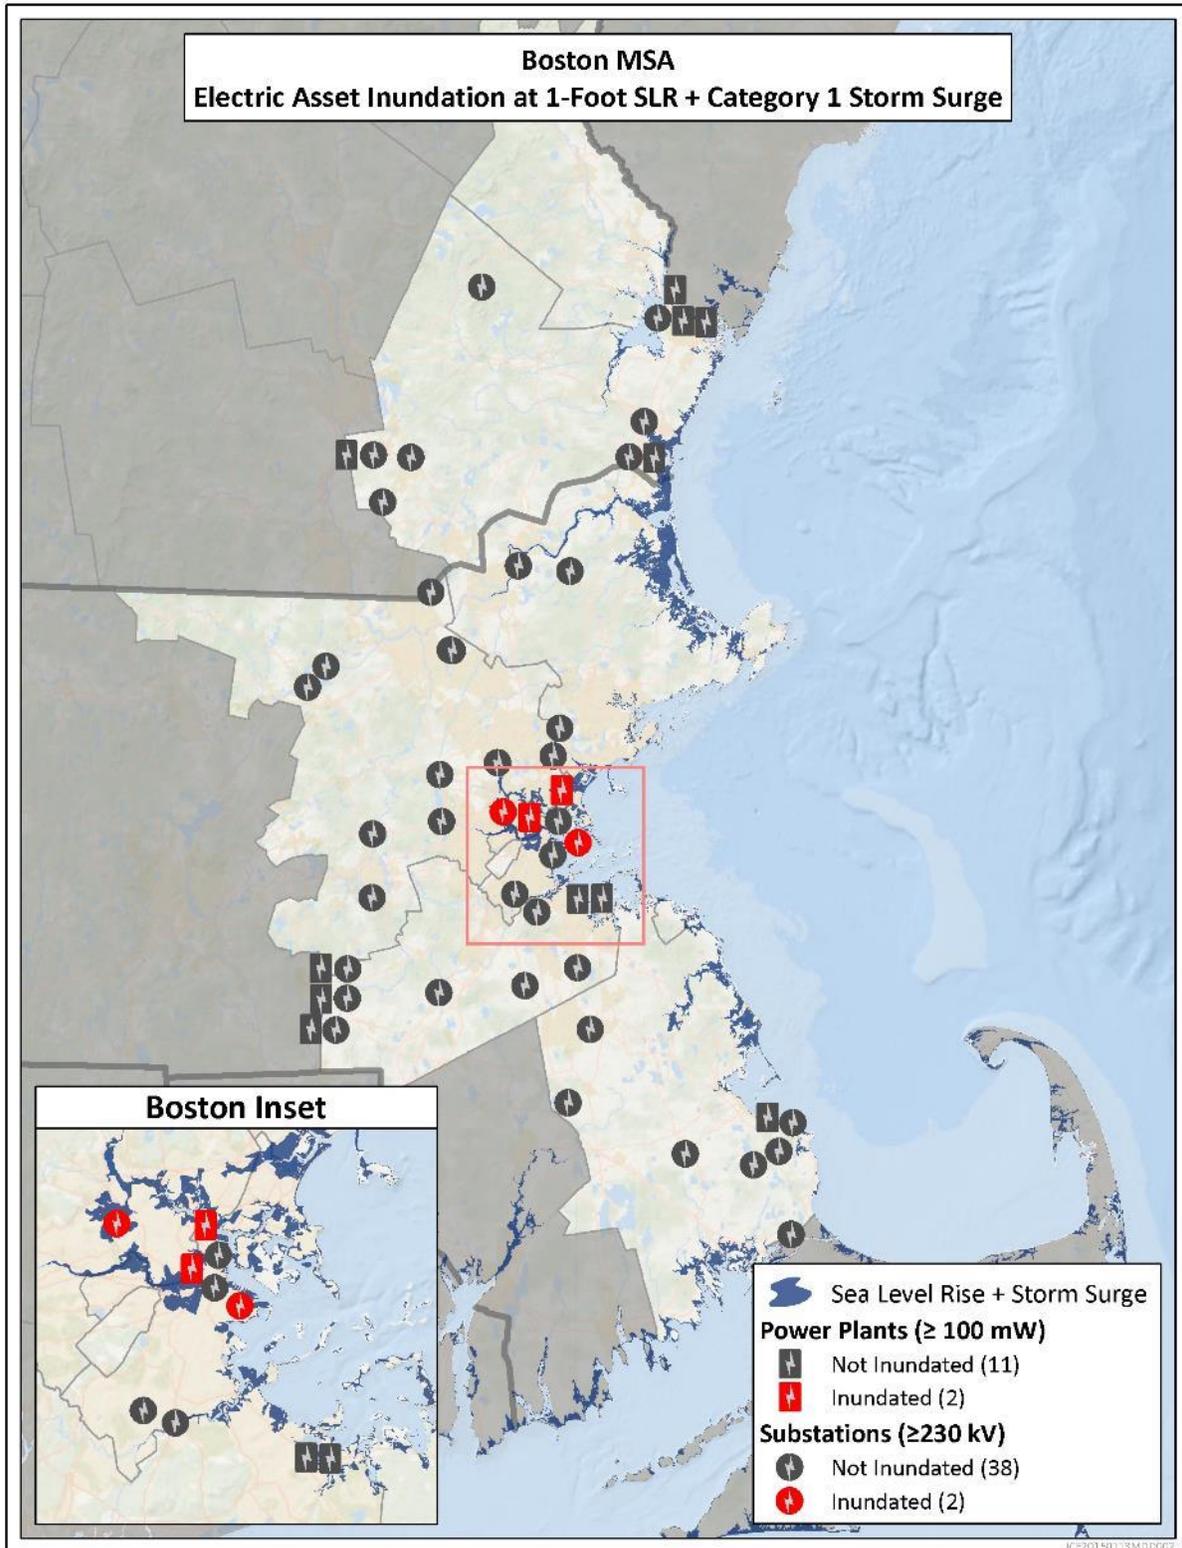


Figure 2b. Large Petroleum and Natural Gas Assets Inundated by 1-Foot SLR under the NCA Intermediate-High Scenario and Category 1 Storm Surge in Boston MSA

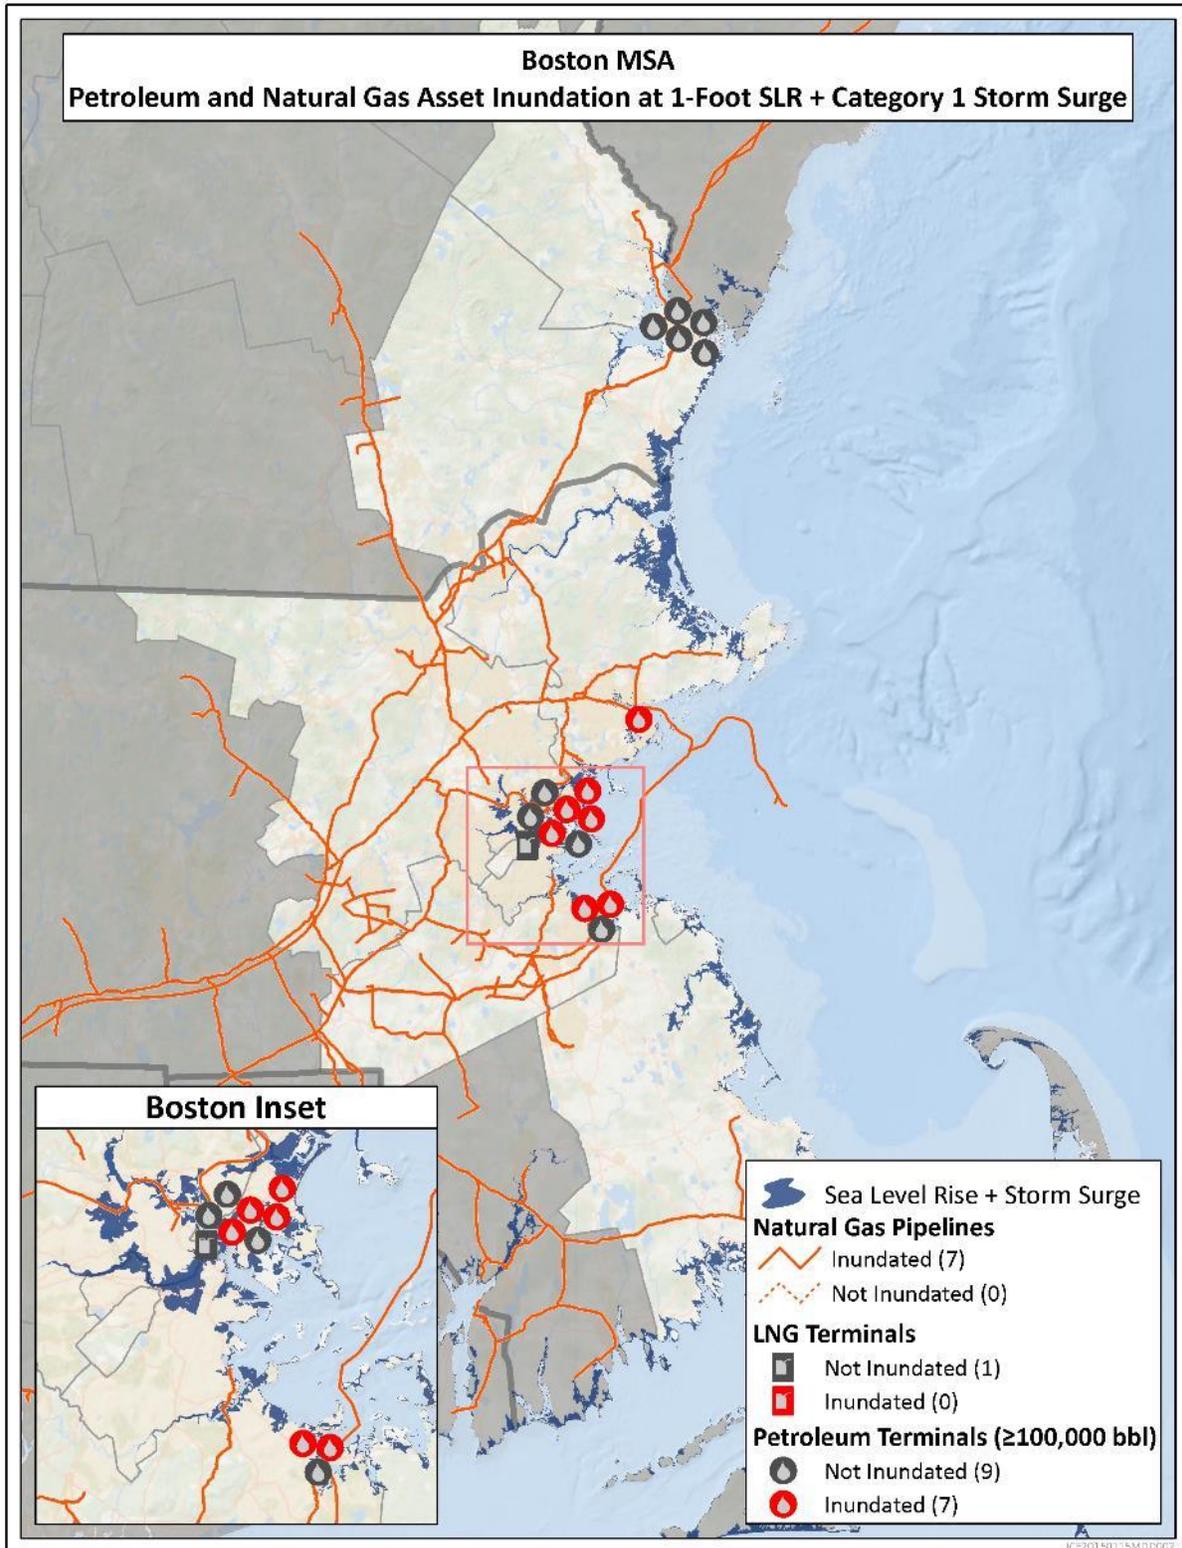


Figure 3a. Large Electricity Assets Inundated by 1-Foot SLR under the NCA Intermediate-High Scenario and Category 4 Storm Surge in Boston MSA

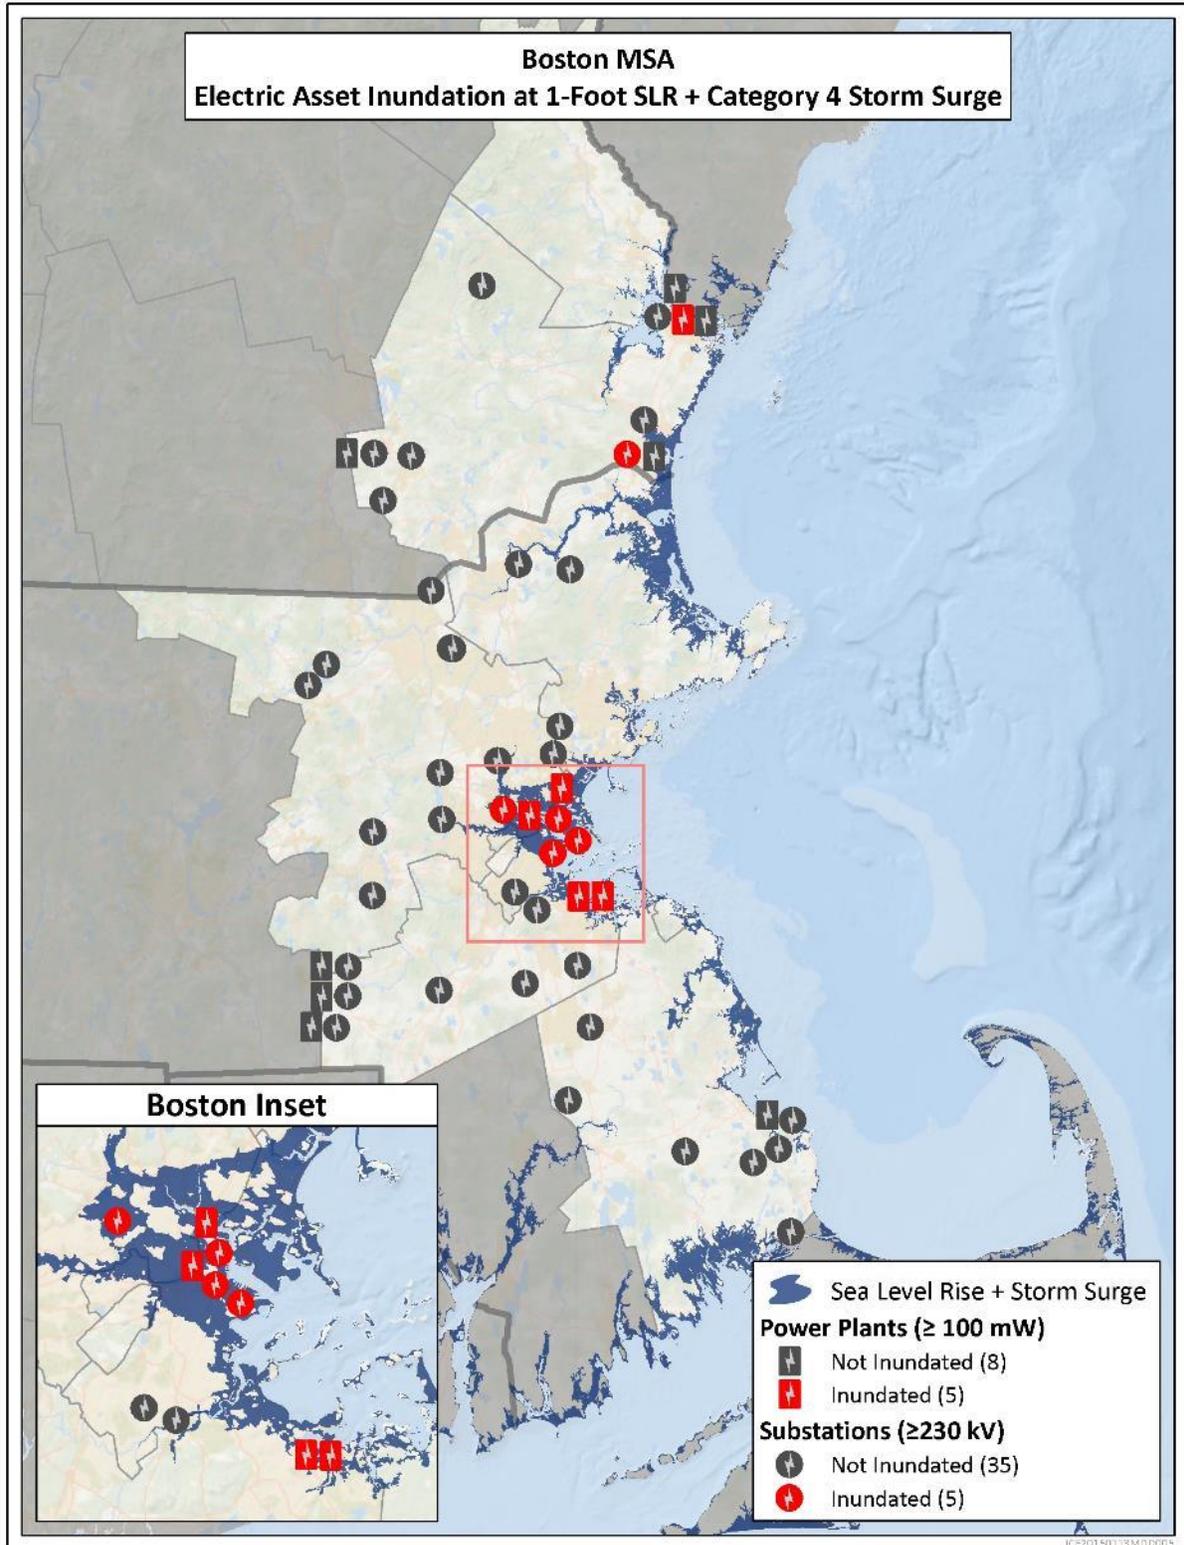


Figure 3b. Large Petroleum and Natural Gas Assets Inundated by 1-Foot SLR under the NCA Intermediate-High Scenario and Category 4 Storm Surge in Boston MSA

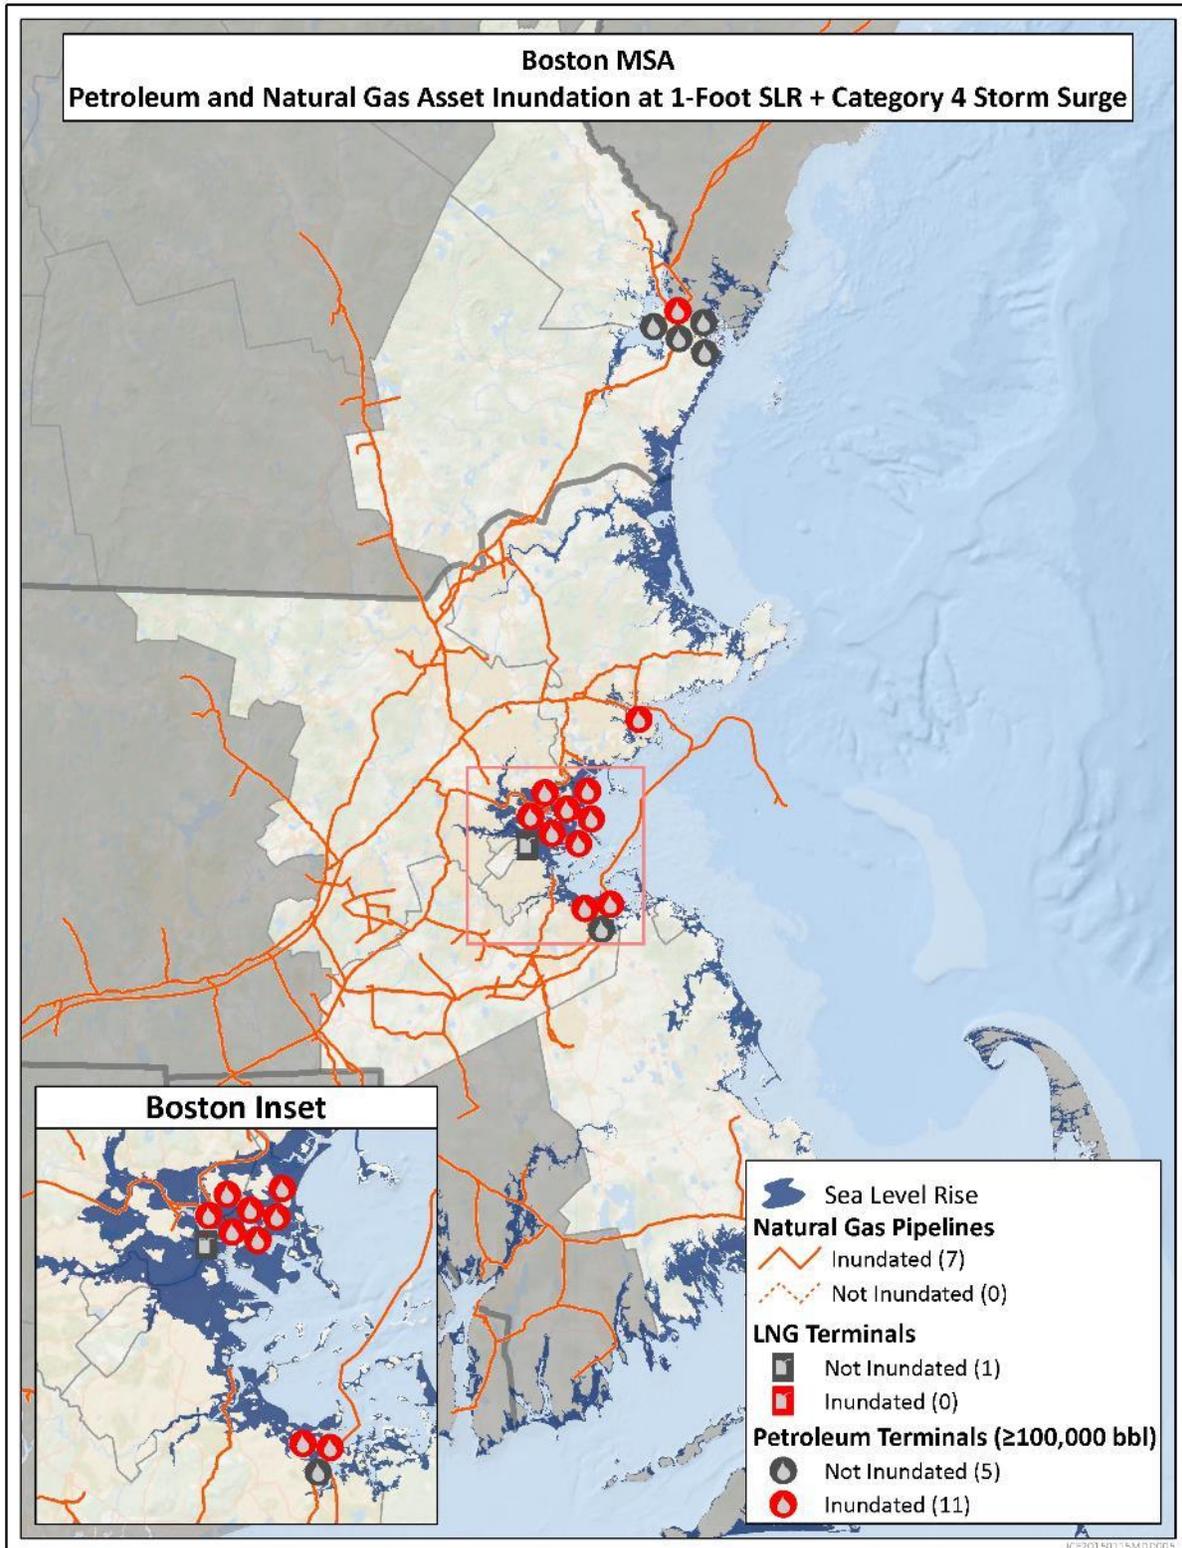


Figure 4a. Large Electricity Assets Inundated by 4-Foot SLR under the NCA Intermediate-High Scenario and Category 1 Storm Surge in Boston MSA

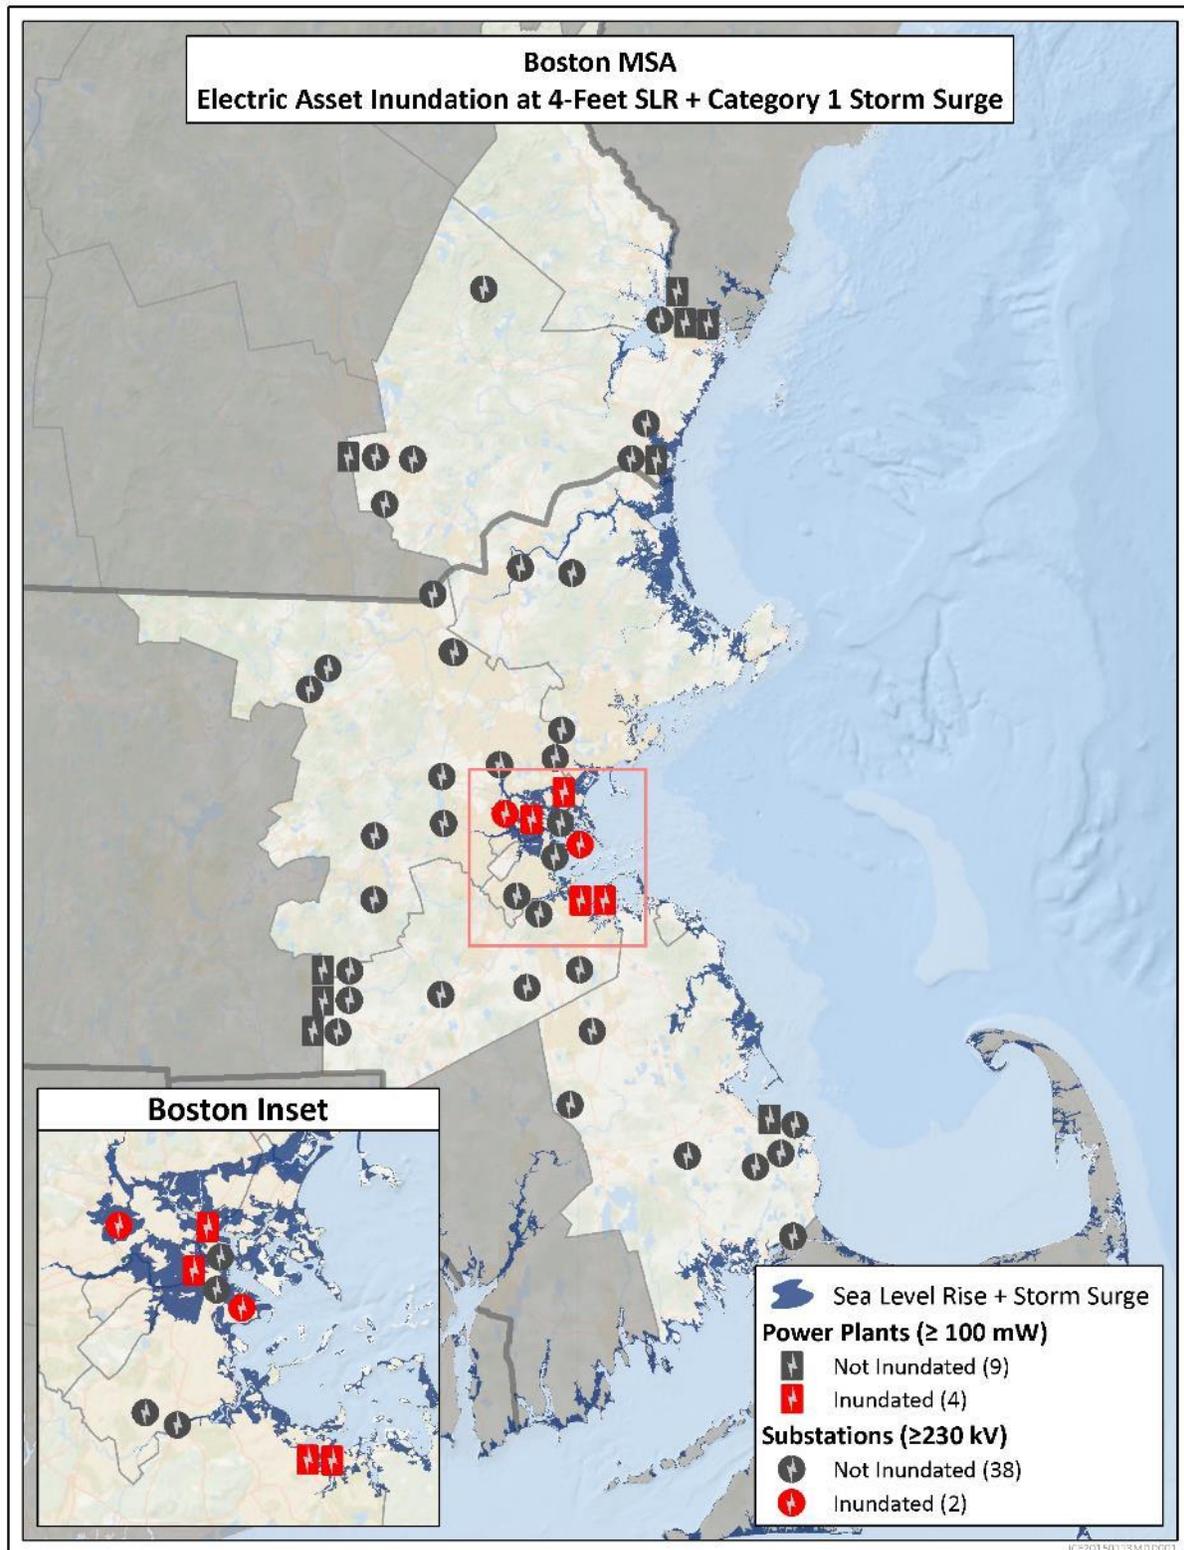


Figure 4b. Large Petroleum and Natural Gas Assets Inundated by 4-Foot SLR under the NCA Intermediate-High Scenario and Category 1 Storm Surge in Boston MSA

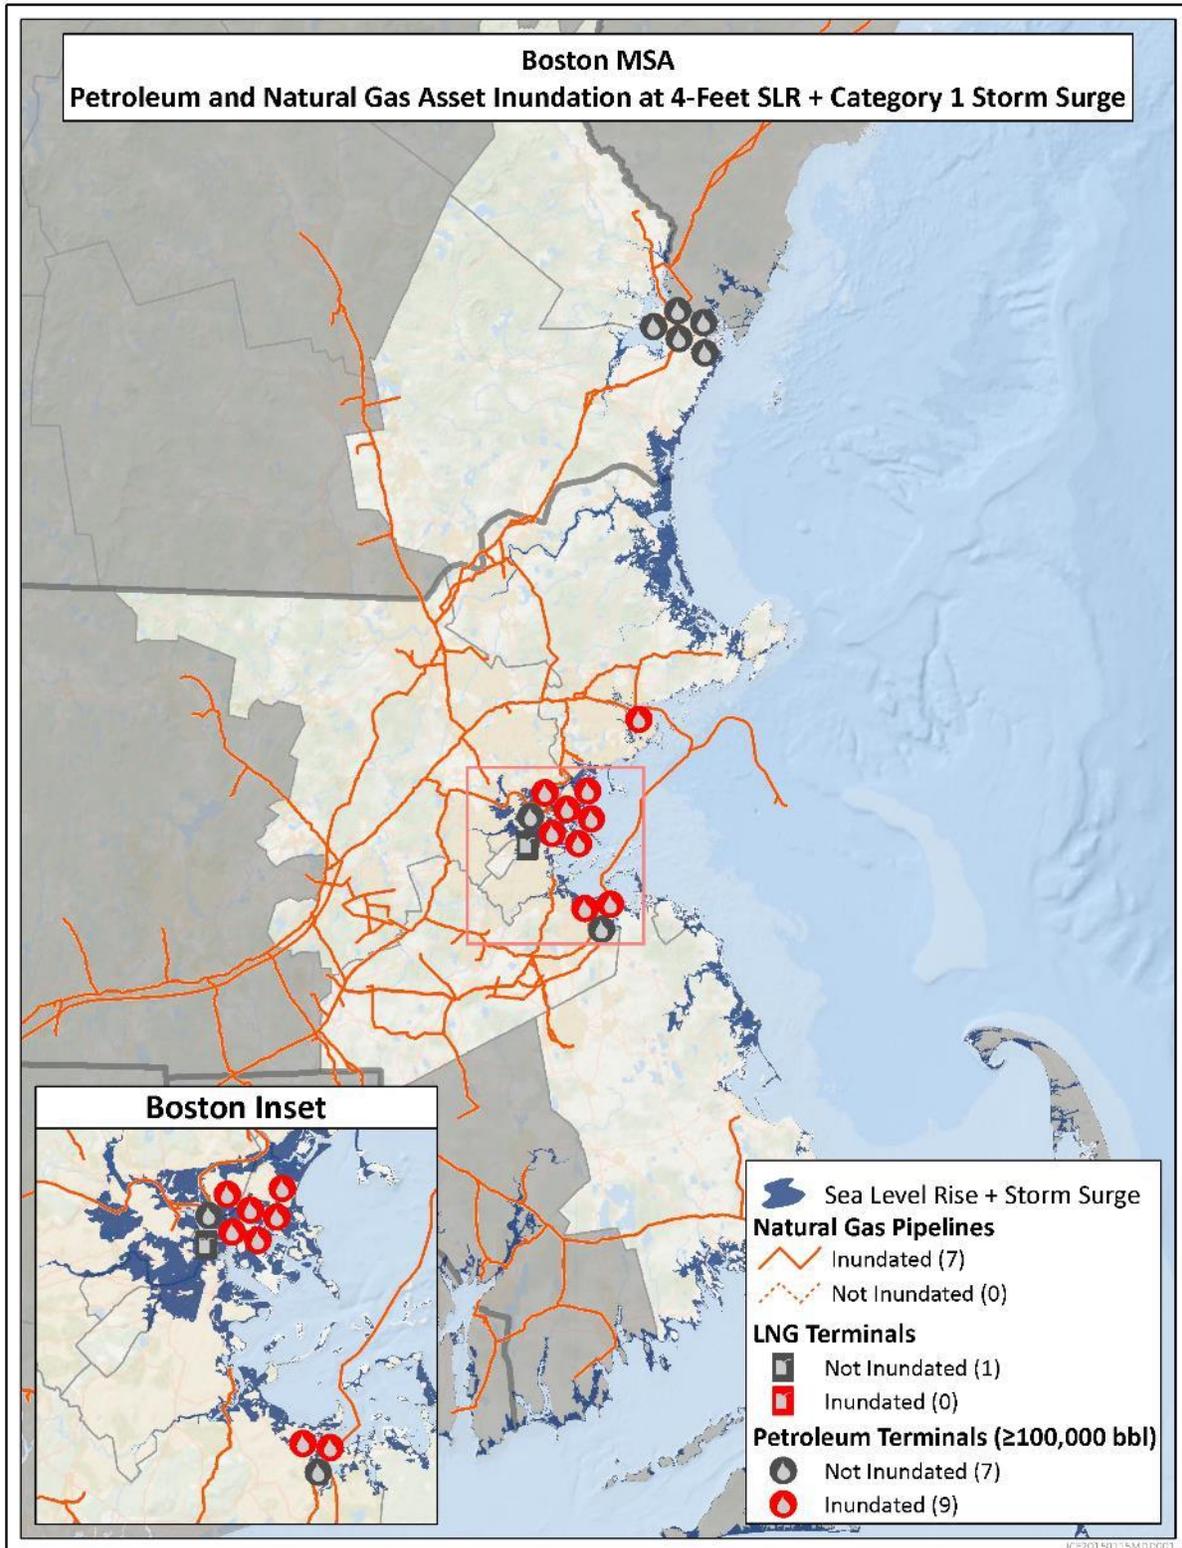


Figure 5a. Large Electricity Assets Inundated by 4-Foot SLR under the NCA Intermediate-High Scenario and Category 4 Storm Surge in Boston MSA


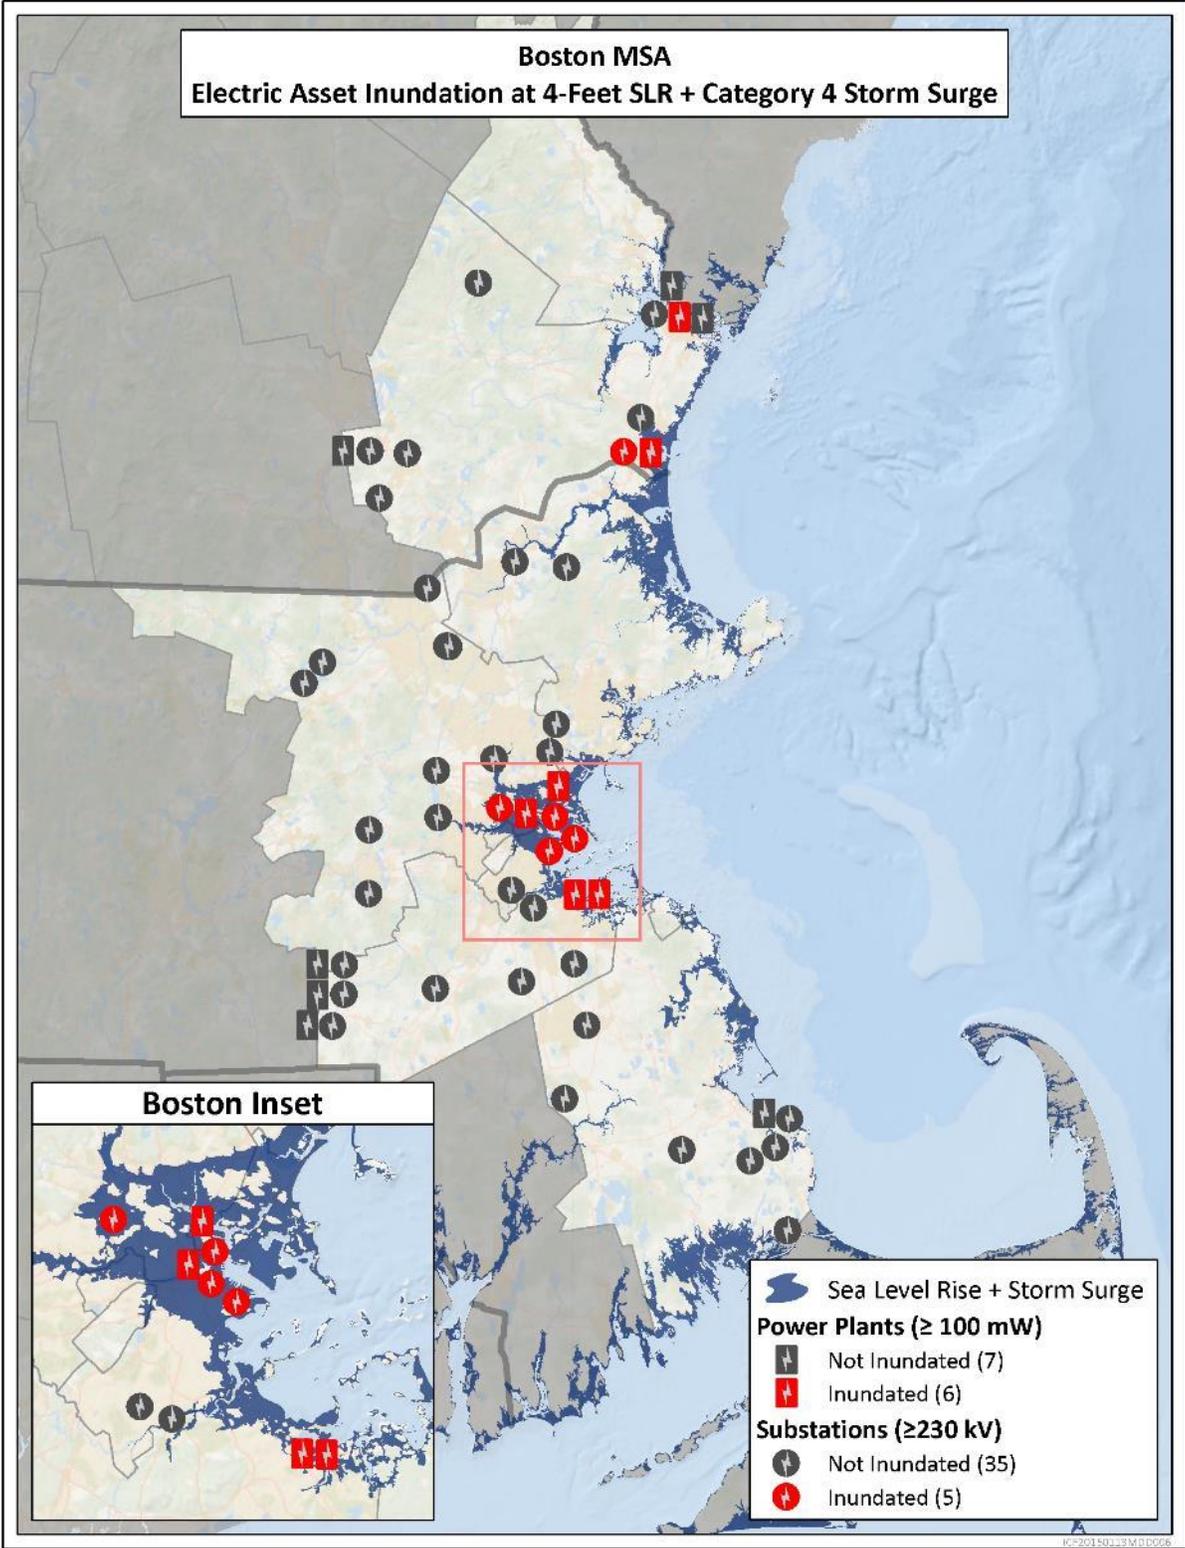


Figure 5b. Large Petroleum and Natural Gas Assets Inundated by 4-Foot SLR under the NCA Intermediate-High Scenario and Category 4 Storm Surge in Boston MSA

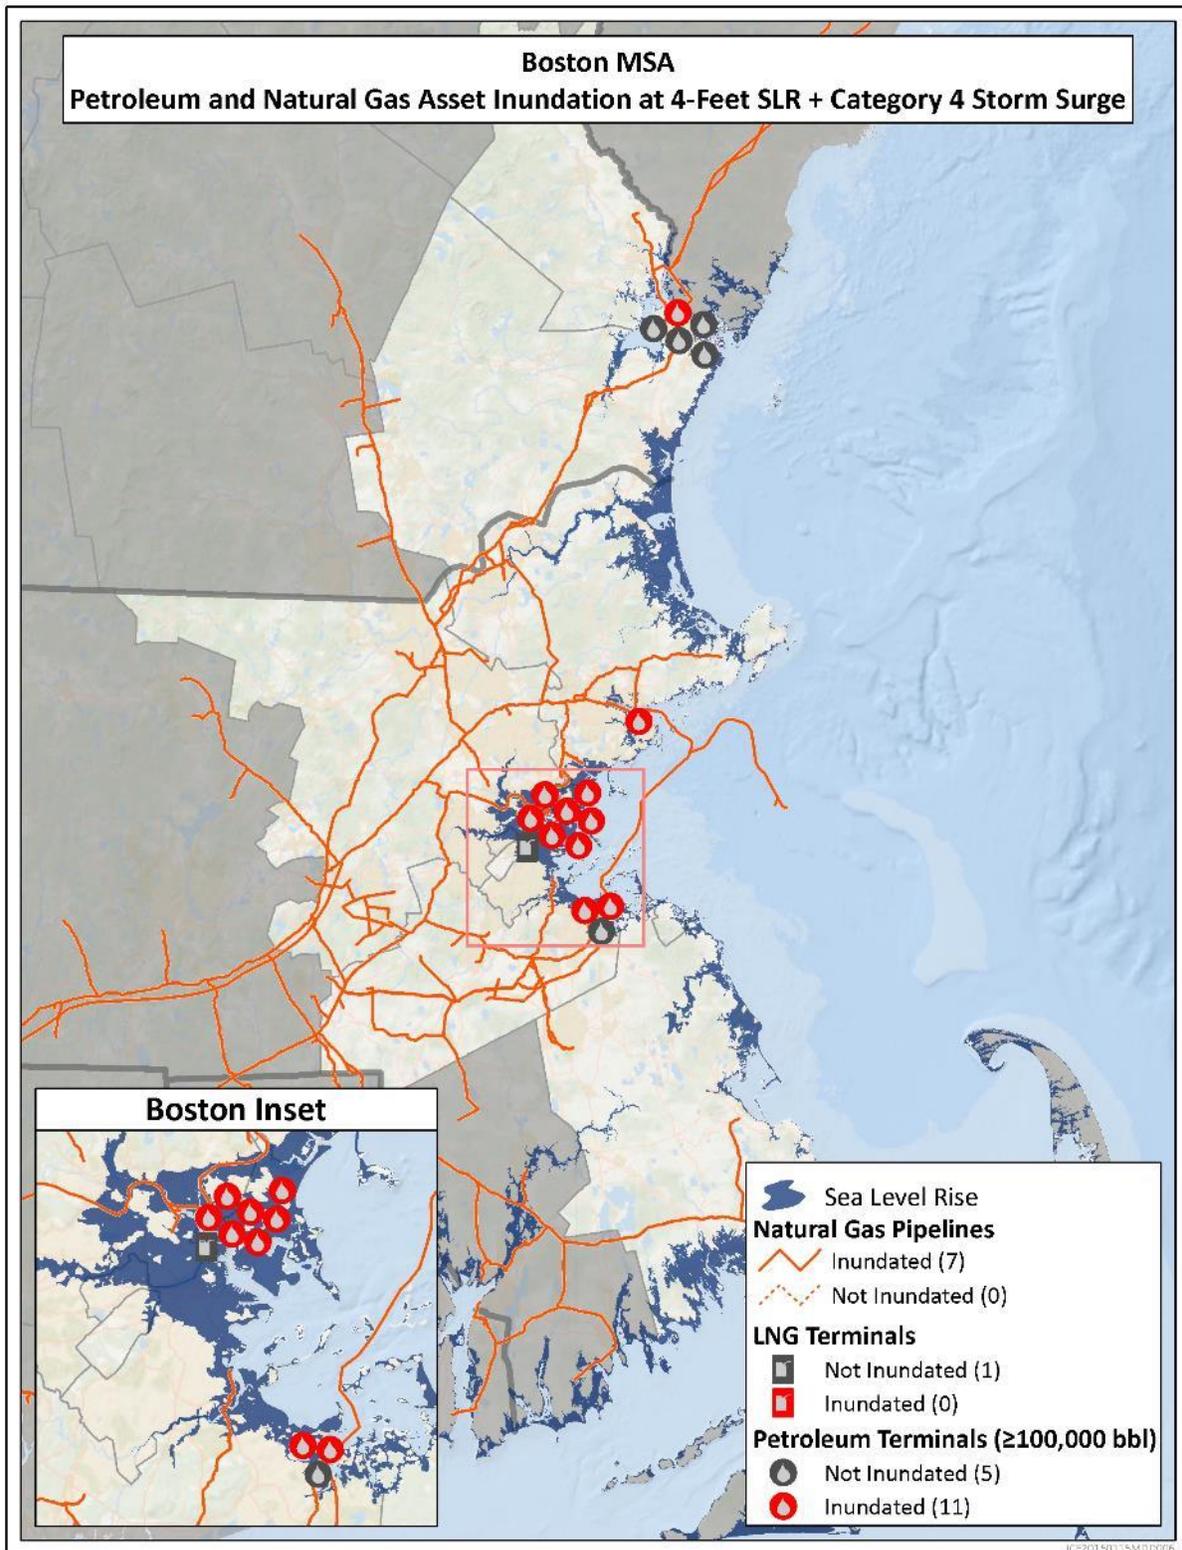

Appendix B: Method for Estimating Areas of Inundation from Sea Level Rise and Storm Surge Combined

The method described below builds on techniques used in a recent study by Oak Ridge National Laboratory.¹⁷

Data Sources

In order to estimate inundation of both sea level changes and areas flooded due to storm surge, several data sets were needed. This analysis made use of existing and well-established data sets where possible and only created new data where necessary. The data sets used include:

- **Sea Level Rise** – While many methods to create sea level rise scenarios are available using geospatial technologies, this report made use of the well-established and accepted data available from the NOAA Coastal Services Center (NOAA CSC).¹⁸ NOAA CSC has created polygons representing the coastline at mean high higher water (MHHW)¹⁹ as sea level changes over time. These are available at 1-foot intervals from zero (present sea level) to 6 feet. The 1- and 4-foot increments were used for this specific study.
- **Storm Surge** – NOAA’s National Weather Service created the Sea, Lake and Overland Surges from Hurricanes (SLOSH)²⁰ model used to estimate storm surge heights associated with hurricanes by simulating the effects of storm size, forward speed, track, wind speed, and atmospheric pressure on water heights in the coastal zone. Data products from the SLOSH model are available for 39 basins along the coasts of the Atlantic Ocean, Gulf of Mexico, Caribbean Sea, and Hawaii that are exposed to hurricanes. SLOSH basins consist of a grid definition as well as various geographic features that route and impede the flow of water. Storm surge within a basin can be represented using a polar, elliptical, or hyperbolic grid with a variable resolution, with the higher resolutions associated with the area of interest. For example, the grid used in the current study for the Boston MSA had a horizontal resolution of approximately 2.9 miles at its furthest point offshore, 0.3 miles at the Coast Guard Station in Boston, and 0.2 miles at its most inland point.

Surge is estimated in these regions by running the model several thousand times with hypothetical hurricanes of varying storm characteristics. A composite of these runs is then used to determine a Maximum Envelope of Water (MEOW), which shows the highest surge values at each grid location for a given storm category, forward speed, and general track direction. This study uses the Maximum of MEOWs, or MOM, for estimates of storm surge heights. This provides the ‘worst case’

¹⁷ Maloney and Preston 2014. A geospatial dataset for U.S. hurricane storm surge and sea-level rise vulnerability: Development and case study applications. *Climate Risk Management*, 2, 26-41.

¹⁸ <http://coast.noaa.gov/slrdata/>

¹⁹ NOAA describes MHHW as “The average of the higher high water height of each tidal day observed over the National Tidal Datum Epoch. For stations with shorter series, comparison of simultaneous observations with a control tide station is made in order to derive the equivalent datum of the National Tidal Datum Epoch.”
http://tidesandcurrents.noaa.gov/datum_options.html

²⁰ <http://www.nhc.noaa.gov/surge/slosh.php>

estimate for a particular storm category, rather than the specific flooding from a particular storm (<http://www.nhc.noaa.gov/surge/momOverview.php>).

Although the latest science indicates that the intensity of the strongest storms may increase in the future,²¹ the potential increase in intensity is difficult to quantify. This analysis includes storms that are stronger than what has previously been experienced in Boston. In the last 100 years, there have been two land-falling Category 3 storms in New England: 1938 and 1954.²² To account for potentially stronger storms in the future, the study analyzes Category 4 storms. Category 1 storms are also analyzed to illustrate the effects of exacerbation from SLR on smaller storms. In the Boston area, intense extratropical storms known as Nor'easters (typically a body of cold air moving from the Northeast across the land colliding with warm, moist air over the ocean moving up from the south) can create storm surges and significant damage. The SLOSH model does not include such events in the historical storms used to calibrate the model, but this analysis covers the plausible future range of storms, including strong Nor'easters, by including Category 4 hurricanes.

- **Elevation** – Land elevation data were used to calculate the sea level and storm surge inundation. The USGS produces the National Elevation Dataset (NED)²³ nationwide. This digital elevation model (DEM) is available in the Boston area at a horizontal scale of 1 arc-second (~30 meters) and was used for this study. The NED also includes a more detailed 10-meter resolution for many areas of the country including Boston, but the coarser elevation data were used to improve processing time and because the increase in elevation resolution would not enhance the results given the coarser resolution of the SLOSH model.

Approach to Estimating Storm Surge Flooding


In order to explore the effects of increased storm surge levels due to sea level changes, an estimate of the areas of potential flooding was made. Generally, and as illustrated in Figure 6 below, the method starts by using the MHHW coastline from the specific NOAA SLR scenario. The depth of inundation from the SLOSH model scenario was added to the depth of inundation from the sea level rise scenario to find the elevation of the storm surge above the SLR scenario. This calculated elevation was then extended toward the coast to find the extent of the possible inundation. These data could then be compared to the infrastructure to determine facilities that may be affected by such a combined scenario (for example, what power plants might be inundated by a Category 4 storm occurring after 4 feet of sea level rise).

²¹ Melillo et al., 2014.

²² <http://www.nhc.noaa.gov/pdf/nws-nhc-6.pdf>

²³ <http://ned.usgs.gov/>

Figure 6. Schematic of Sea Level Rise Plus Storm Surge Analysis

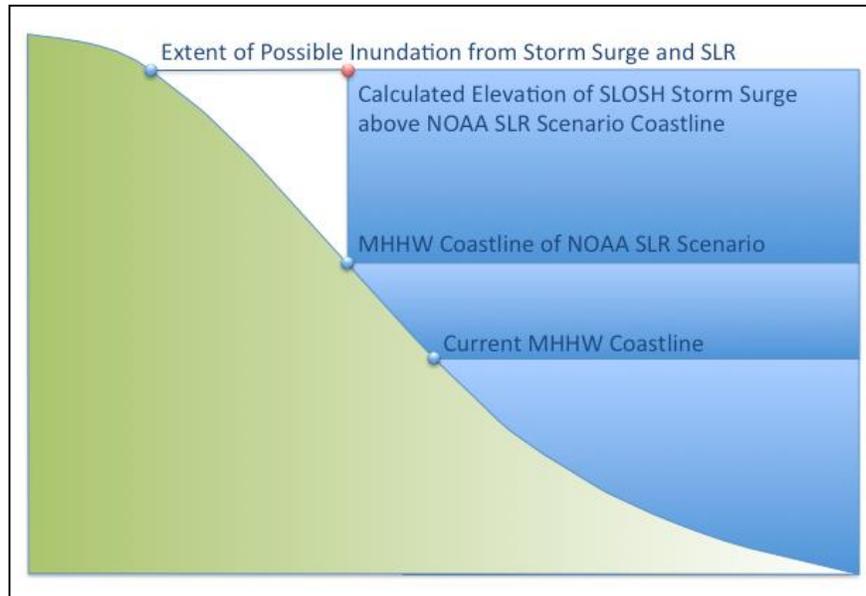

Specifically, the analysis goes through the following steps:

- Using ArcGIS 10.2 (Esri) to perform the spatial analysis functions, a series of observation points were created from the polygons of the specific NOAA CSC sea level rise scenario (1 and 4 foot).
- These points were spatially overlaid on the SLOSH model output for a specific Saffir-Simpson category of storm (Category 1 and Category 4) to join the depth of inundation at that location to the observation points.
- Those same points were compared with the NED elevation model to join the elevation to the observation points. Then, the elevation and depth of inundation values were added to get a height of water for that particular scenario at that observation point.
- With the series of points now having an estimate of inundation an Inverse Distance Weighting²⁴ was calculated from the observation points to create a continuous surface, modeling the given sea level and storm surge scenario. The output was set to same resolution as the DEM—30m.
- The resulting output surface was compared to the elevation of the DEM. Given that the vertical accuracy of NED elevation model is expressed as a root mean square error of 2.44 m²⁵ and the various uncertainties associated with the SLOSH model, the resulting inundation grids did not maintain any depth of inundation data. Instead, areas where the scenario was higher than the DEM elevation were considered inundated and conversely, areas where the scenario was lower than the DEM elevation were considered dry—or not inundated.

²⁴ Inverse distance weighted (IDW) interpolation determines cell values using a linearly weighted combination of a set of sample points (Esri – 2014).

²⁵ D.B. Gesch, The national elevation dataset, D. Maune (Ed.), Digital Elevation Model Technologies and Applications: The DEM Users Manual (second ed.), American Society for Photogrammetry and Remote Sensing, Bethesda, Maryland (2007), pp. 99–118

- The inundated cells were converted to polygons representing areas of inundation. These polygons were then used to identify which energy infrastructure facilities could be at risk of inundation based on the specific sea level rise and storm surge scenario.